


# FALCO-ECOM CONFIGURATION LIFT ACCESS SYSTEM

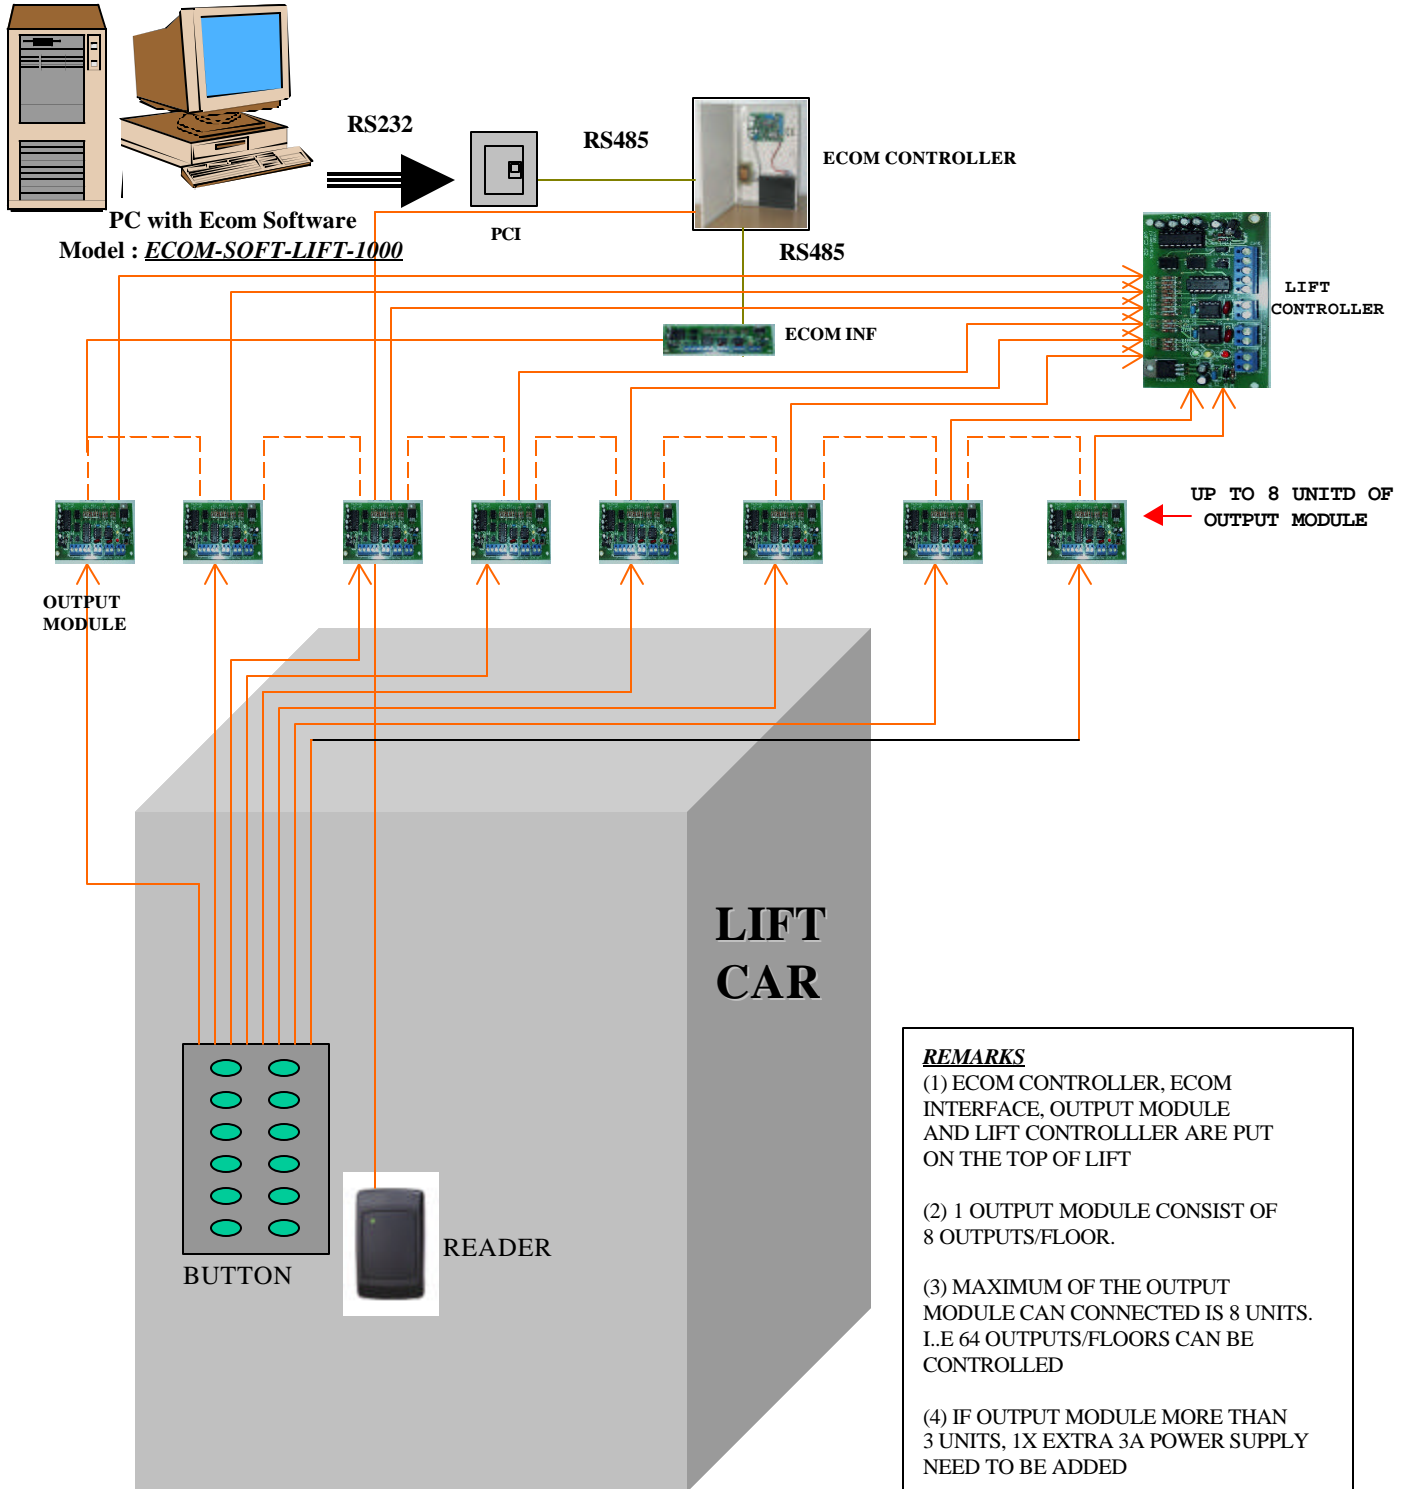

**REMARKS**

- (1) ECOM CONTROLLER, ECOM INTERFACE, OUTPUT MODULE AND LIFT CONTROLLER ARE PUT ON THE TOP OF LIFT
- (2) 1 OUTPUT MODULE CONSIST OF 8 OUTPUTS/FLOOR.
- (3) MAXIMUM OF THE OUTPUT MODULE CAN CONNECTED IS 8 UNITS. I.E 64 OUTPUTS/FLOORS CAN BE CONTROLLED
- (4) IF OUTPUT MODULE MORE THAN 3 UNITS, 1X EXTRA 3A POWER SUPPLY NEED TO BE ADDED